

Client:

الهيئة الهندسية للقوات المسلحة

Main Consultant:

Project Name:

Governmental District
The Presidential Park
Egypt Administrative Capital

Key Plan:

Notes:

- FOR GRAPHICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES REFER TO DRAWING NO. PE20851C-FD-GEN-TD-001.
- FOR FIRE ALARM SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR00-TX-001.
- FOR IP TELEPHONY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR00-TX-001.
- FOR SECURITY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR00-TX-001.
- FOR STRUCTURED CABLING SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR00-TX-001.
- FOR FIRE ALARM DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TF-001.
- FOR STRUCTURED CABLING DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-001.
- FOR ACCESS CONTROL DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-001.
- FOR VIDEO SURVEILLANCE DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-001.
- THE CONTRACTOR TO PROVIDE 205MM CONDUITS FOR CONNECTIVITY BETWEEN TELECOM ROOM/CLOSET TO EACH TENANT AREA AND UP TO TTC CABINET.

FOR CONSTRUCTION
FEBRUARY 2021


No.	Description	Date	M.K.	App.
0	APPROVED ISSUE	10/02/2021	M.K.	

Drawing Title:

PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01
GROUND FLOOR
FIRE ALARM SYSTEM LAYOUT

Designed	Checked	Approved
W.A.	N.S.	M.K.
Drawn	Date	Scale
A.S.	10/02/2021	1 : 100

Project No.	Phase	Project part	Department Acronym	Sheet No.	Rev.
PE20851C	FD	CR01	TF	101	0

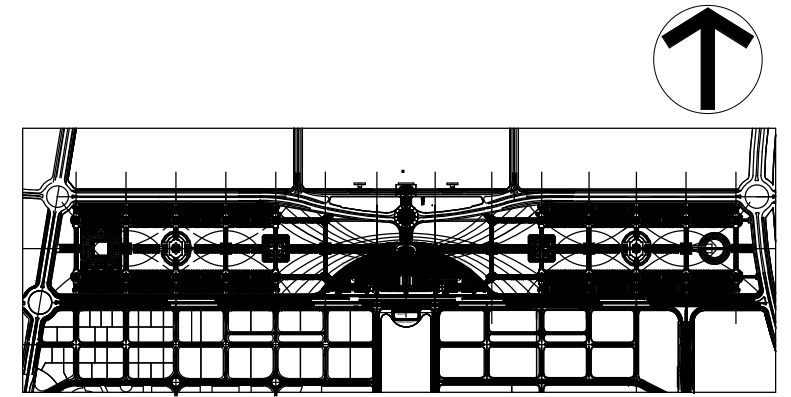


1.	FOR GRAPHICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES REFER TO DRAWING NO. PE20851C-FD-GEN-TG-001.
2.	
3.	FOR FIRE ALARM SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001.
4.	FOR P/PE TELEPHONE SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001.
5.	FOR SECURITY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001.
6.	FOR STRUCTURED CABLING SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001.
7.	FOR FIRE ALARM CABLES REFER TO DWG NO. PE20851C-FD-GEN-TG-001.
8.	FOR STRUCTURED CABLES DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001.
9.	FOR ACCESS CONTROL DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001.
10.	FOR VIDEO SURVEILLANCE DETAILS REFER TO DWG NO. PE20851C-FD-VIDEO-TX-002.
11.	THE CONTRACTOR TO PROVIDE 2050MM CONDUIT FOR CONNECTIVITY BETWEEN TELECOM ROOMS/LOCS TO EACH TRENCH AND INTO THE T/C CABINET.


<div style="border: 1px solid black; padding: 5px; text-align: center;"> FOR CONSTRUCTION FEBRUARY 2021 </div>			
0	APPROVED ISSUE	10/02/2021	M.K.
No.	Description	Date	App.

PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01
MEZZANINE FLOOR
FIRE ALARM SYSTEM LAYOUT

Designed W.A.		Checked N.S.		Approved M.K.	
Drawn A.S.		Date 10/02/2021		Scale 1 : 100	
PE20851C	FD	CR01	TF		102
Project No.	Phase	Project part	Department Acronym		Sheet No.

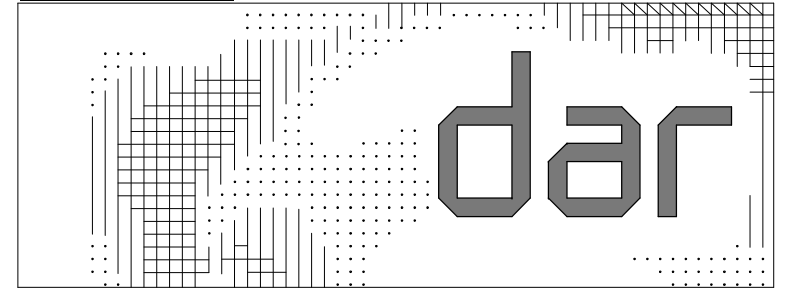

**Governmental District
The Presidential Park
Egypt Administrative Capital**

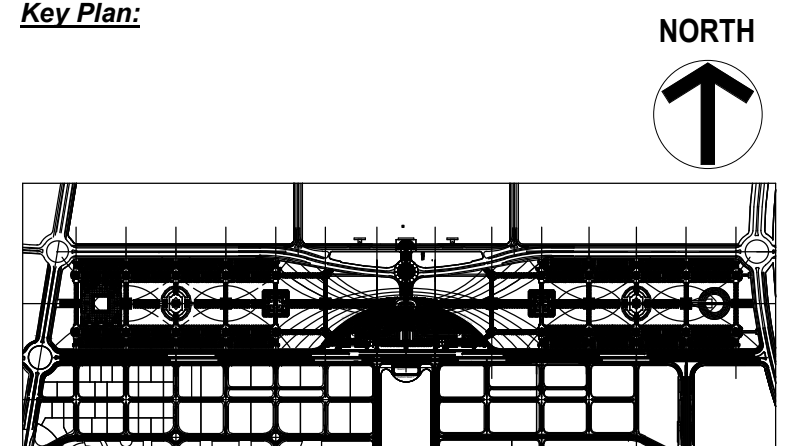

Notes:

- | | |
|-----|---|
| 1. | FOR GRAPHICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES REFER TO DRAWING NO. PE20851C-FD-GEN-TG-001. |
| 2. | |
| 3. | FOR FIRE ALARM SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001. |
| 4. | FOR P/PE TELEPHONY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001. |
| 5. | FOR SECURITY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001. |
| 6. | FOR STRUCTURED CABLING SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROD-TX-001. |
| 7. | FOR FIRE ALARM CABLES REFER TO DWG NO. PE20851C-FD-GEN-TG-001. |
| 8. | FOR STRUCTURED CABLES DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001. |
| 9. | FOR ACCESS CONTROL DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001. |
| 10. | FOR VIDEO SURVEILLANCE DETAILS REFER TO DWG NO. PE20851C-FD-VIDEO-TX-002. |
| 11. | THE CONTRACTOR TO PROVIDE 2050MM CONDUIT FOR CONNECTIVITY BETWEEN TELECOM ROOMS/LOCS TO EACH TRENCH AND INTO THE TIE CABINET. |

FOR CONSTRUCTION
FEBRUARY 2021

Drawing Title:


PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01
GROUND FLOOR
TELECOMMUNICATION SYSTEMS
LAYOUT

Designed W.A.		Checked N.S.		Approved M.K.	
Drawn A.S.		Date 10/02/2021		Scale 1 : 100	
PE20851C	FD	CR01	TT	101	0
Project No.	Phase	Project part	Department Acronym	Sheet No.	Rev

0	APPROVED ISSUE	10/02/2021	M.K.
No.	Description	Date	App.

PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01 -
MEZZANINE FLOOR
TELECOMMUNICATION SYSTEMS
LAYOUT

Designed W.A.		Checked N.S.		Approved M.K.	
Drawn A.S.		Date 10/02/2021		Scale 1 : 100	
PE20851C	FD	CR01	TT	102	0
Project No.	Phase	Project part	Department Acronym	Sheet No.	Rev

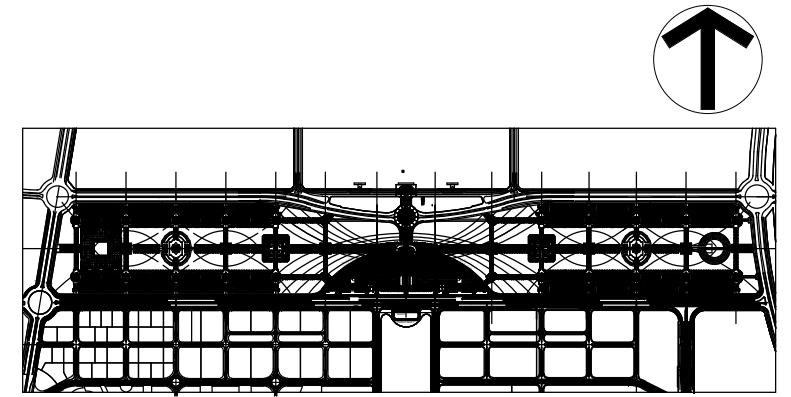

1.	FOR GRAPHICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES REFER TO DRAWING NO. PE20851C-FD-GEN-TG-001.
2.	
3.	FOR FIRE ALARM SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROQ-TX-001.
4.	FOR P/ TELEPHONY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROQ-TX-001.
5.	FOR SECURITY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROQ-TX-001.
6.	FOR STRUCTURED CABLING SCHEMATIC REFER TO DWG NO. PE20851C-FD-CROQ-TX-001.
7.	FOR FIRE ALARM CABLES REFER TO DWG NO. PE20851C-FD-GEN-TG-001.
8.	FOR STRUCTURED CABLES DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001.
9.	FOR ACCESS CONTROL DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TT-001.
10.	FOR VIDEO SURVEILLANCE DETAILS REFER TO DWG NO. PE20851C-FD-VIDEO-TX-002.
11.	THE CONTRACTOR TO PROVIDE 2050MM CONDUIT FOR CONNECTIVITY BETWEEN TELECOM ROOMS/SETS TO EACH TRENCH AND INTO THE TIE CABINET.

FOR CONSTRUCTION
FEBRUARY 2021

0	APPROVED ISSUE	10/02/2021	M.K.
No.	Description	Date	App.

PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01 -
GROUND FLOOR
SECURITY SYSTEMS LAYOUT

Designed W.A.		Checked N.S.		Approved M.K.	
Drawn A.S.		Date 10/02/2021		Scale 1 : 100	
PE20851C	FD	CR01	TY		101
Project No.	Phase	Project part	Department Acronym		Sheet No.

5

4

3

2


1

Client:

الهيئة الهندسية للقوات المسلحة




Main Consultant:

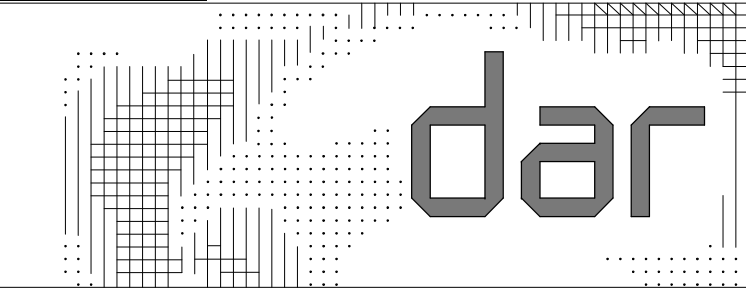

Project Name:

Governmental District
The Presidential Park
Egypt Administrative Capital

Key Plan:

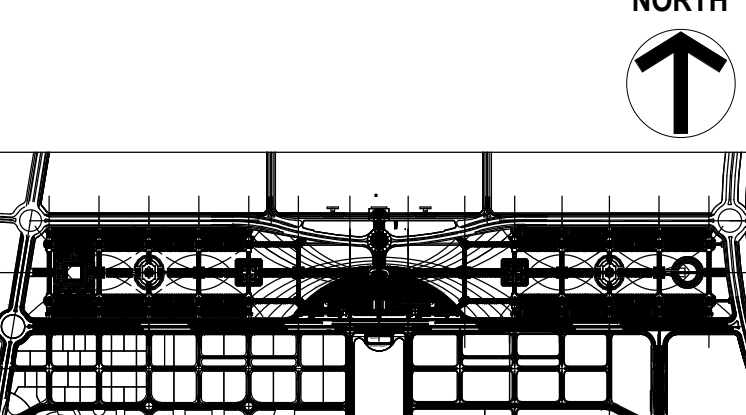

Notes:

- FOR GRAPHICAL SYMBOLS, ABBREVIATIONS AND GENERAL NOTES REFER TO DRAWING NO. PE20851C-FD-GEN-10-001.
- FOR FIRE ALARM SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR03-TX-001.
- FOR IP TELEPHONY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR04-TX-001.
- FOR SECURITY SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR05-TX-001.
- FOR STRUCTURED CABLING SCHEMATIC REFER TO DWG NO. PE20851C-FD-CR06-TX-001.
- FOR FIRE ALARM DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TF-001.
- FOR STRUCTURED CABLING DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-001.
- FOR ACCESS CONTROL DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-002.
- FOR VIDEO SURVEILLANCE DETAILS REFER TO DWG NO. PE20851C-FD-GEN-TY-003.
- THE CONTRACTOR TO PROVIDE 205MM CONDUITS FOR CONNECTIVITY BETWEEN TELECOM ROOM/CLOSET TO EACH TENANT AREA AND UP TO TTC CABINET.


FOR CONSTRUCTION
FEBRUARY 2021

0	APPROVED ISSUE	10/02/2021	M.K.
No.	Description	Date	App.

Drawing Title:

PRESIDENTIAL PARK
CAFÉ RESTAURANT BUILDING CR01 -
MEZZANINE FLOOR
SECURITY SYSTEMS LAYOUT

Designed	Checked	Approved
W.A.	N.S.	M.K.
Drawn	Date	Scale
A.S.	10/02/2021	1 : 100
PE20851C	FD	CR01
Project No.	Phase	Project part
		Department Acronym
		Sheet No.
		Rev.

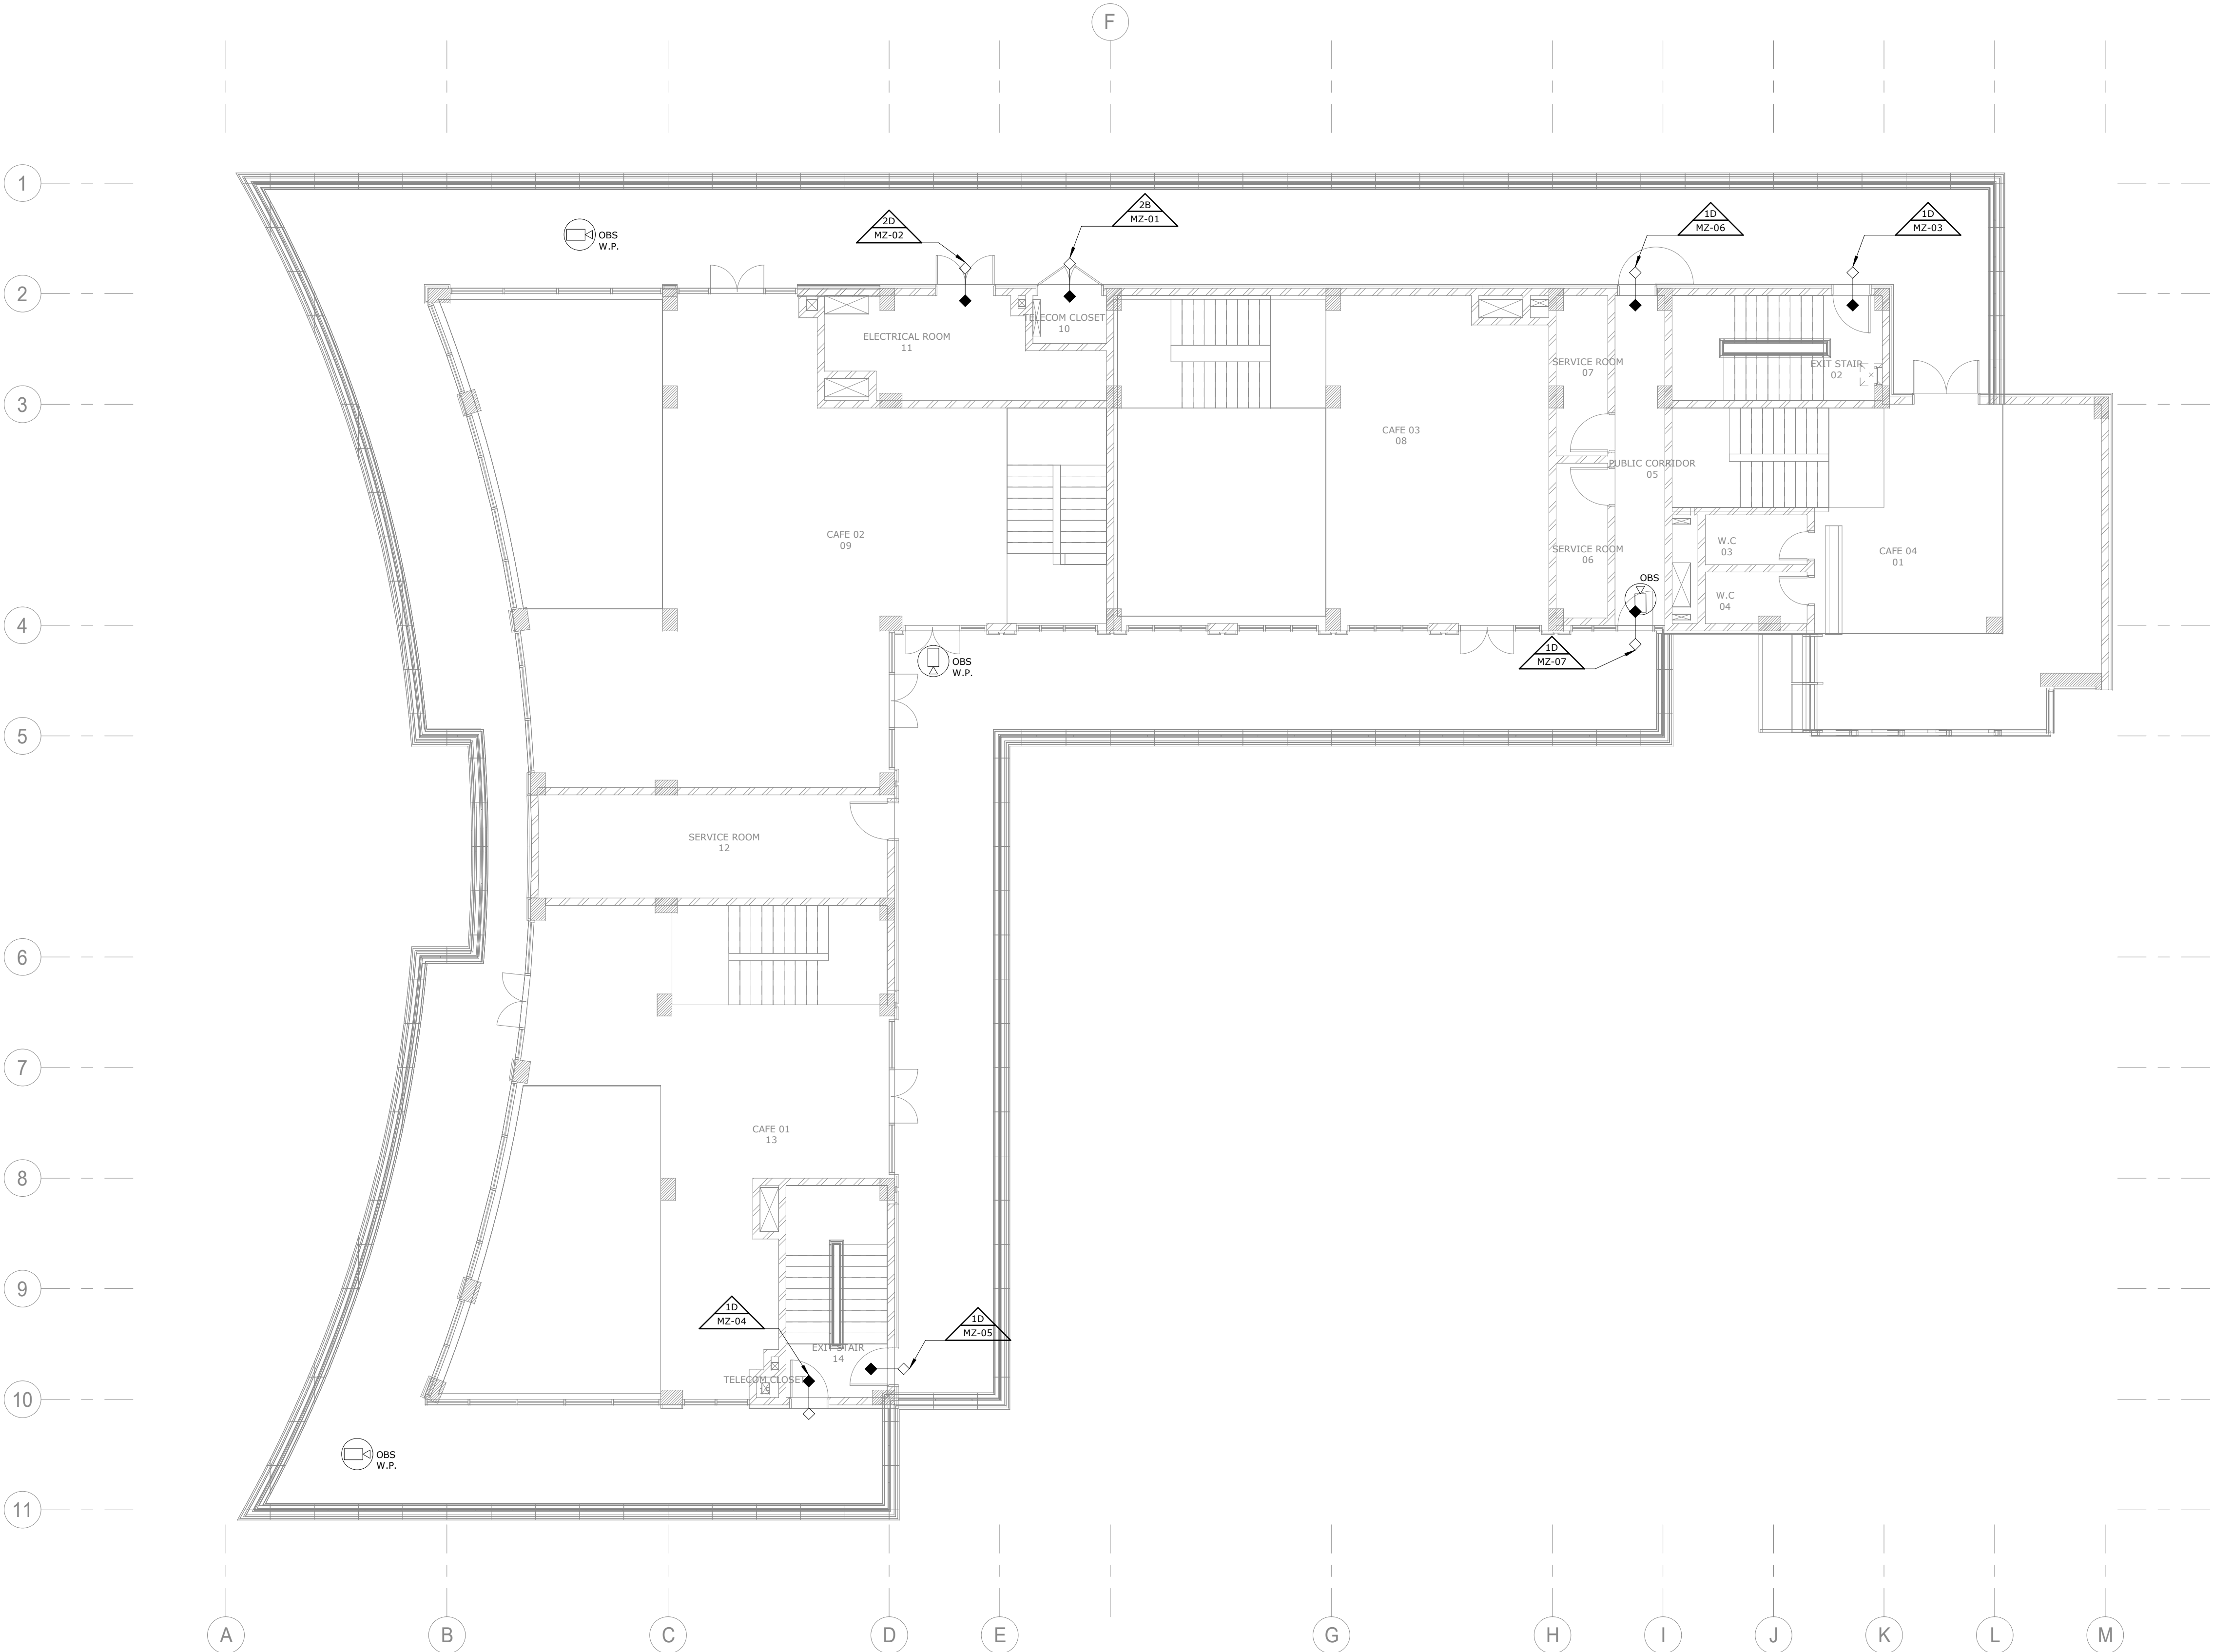

5

4

3

2